



PH

Date	07.07.21	13.07.21	21.07.21	27.07.21
Warning Levels	6.8	6.8	6.8	6.8
Max	9	9	9	9
Min	6	6	6	6
Reading	6.83	6.78	6.85	6.75

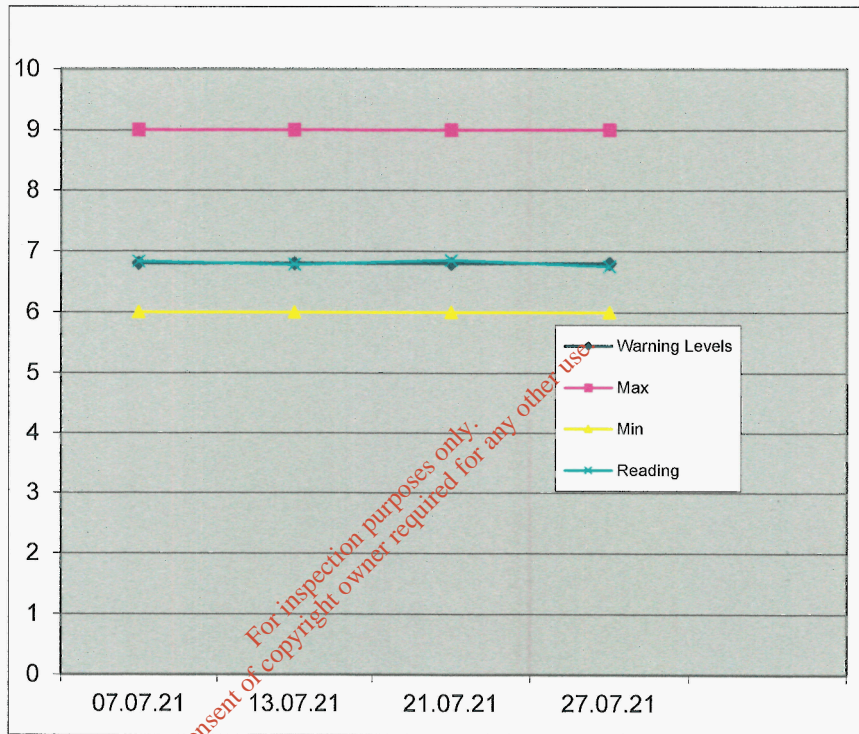


PHOSPHOROUS

Date	07.07.21	13.07.21	21.07.21	27.07.21
Warning Level	0.2	0.2	0.2	0.2
Limit	0.35	0.35	0.35	0.35
Reading	0.21	0.24	0.3	0.27

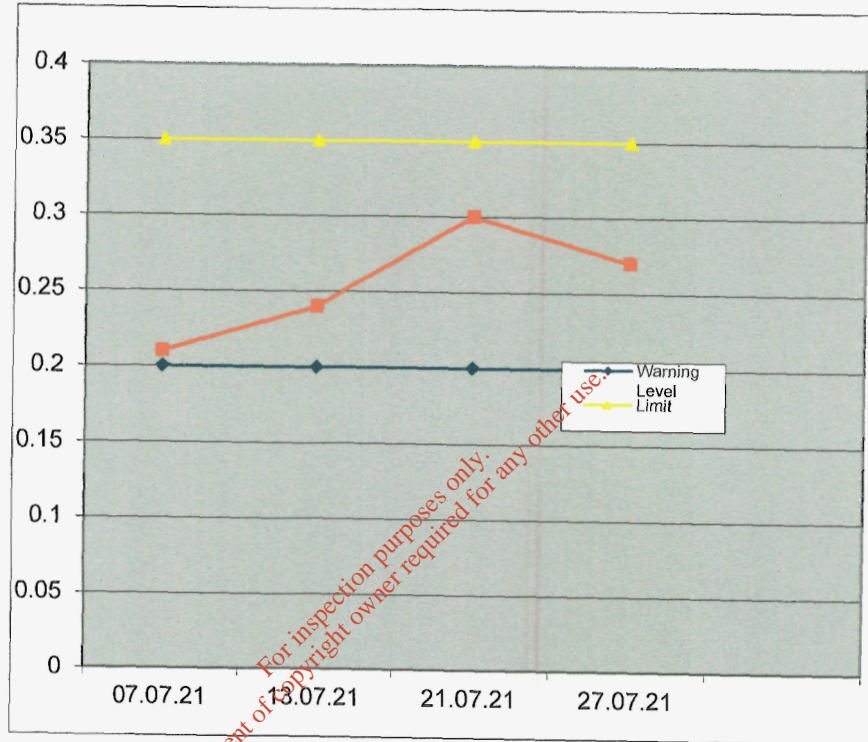


NITROGEN

Date	07.07.21	13.07.21	21.07.21	27.07.21
Warning Levels	13	13	13	13
Limit	15	15	15	15
Reading	6	6.6	7.3	7

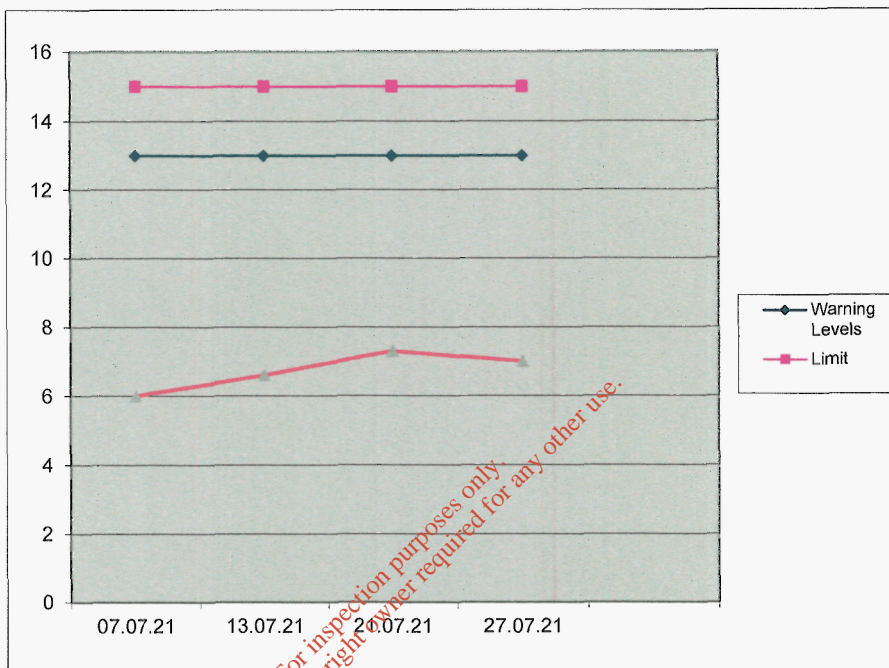


BOD

Date	07.07.21	13.07.21	21.07.21	27.07.21
Warning Levels	8	8	8	8
Limit	10	10	10	10
Reading	2	2	2	2

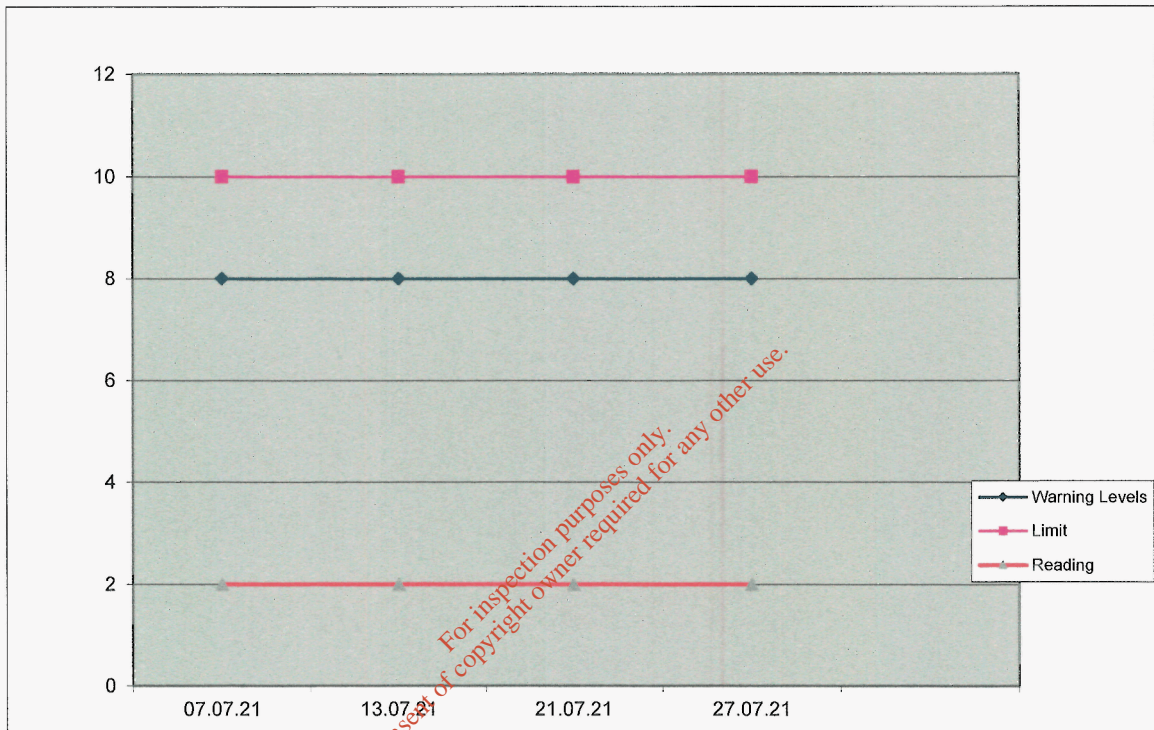


S SOLIDS

Date	07.07.21	13.07.21	21.07.21	27.07.21
Warning Levels	13	13	13	13
Limit	15	15	15	15
Reading	9	10	14	13

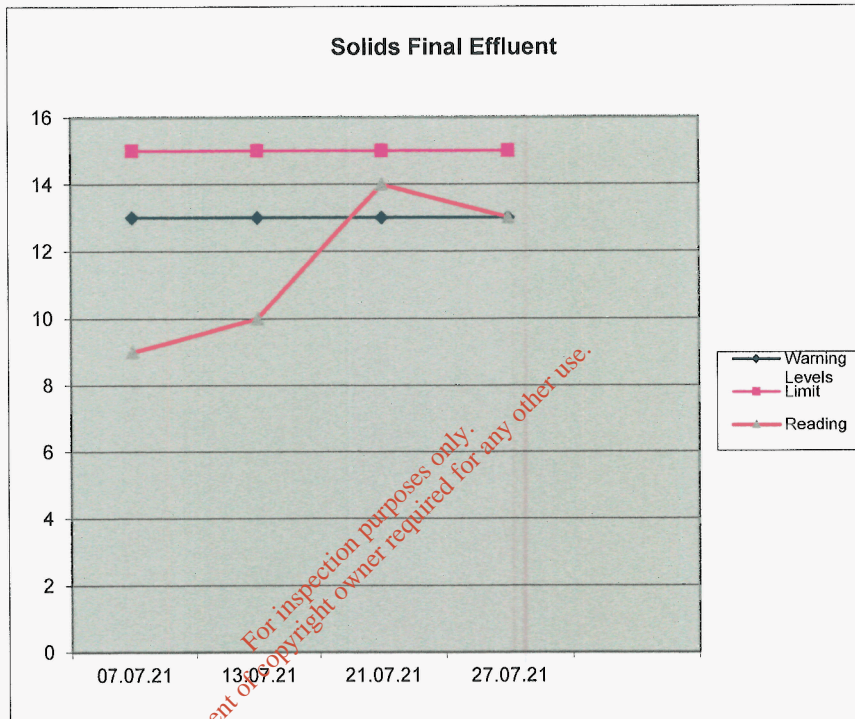


AMMONIA

Date	07.07.21	13.07.21	21.07.21	27.07.21
Warning Levels	0.3	0.3	0.3	0.3
Limit	0.65	0.65	0.65	0.65
Reading	0.15	0.2	0.22	0.22

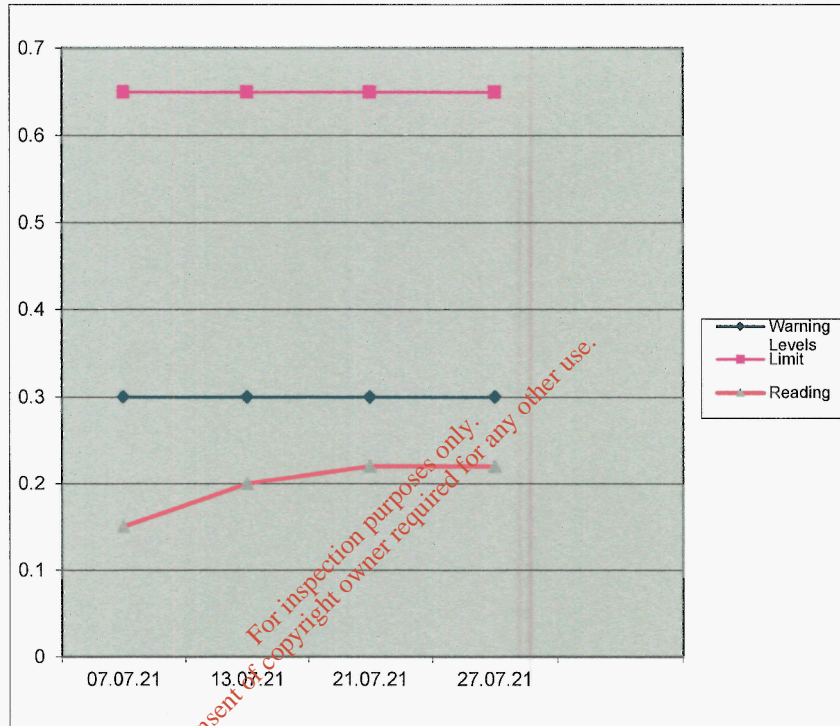

Date	07.07.21	13.07.21	21.07.21	27.07.21
Limit	80	80	80	80
Reading	18	25	29	23

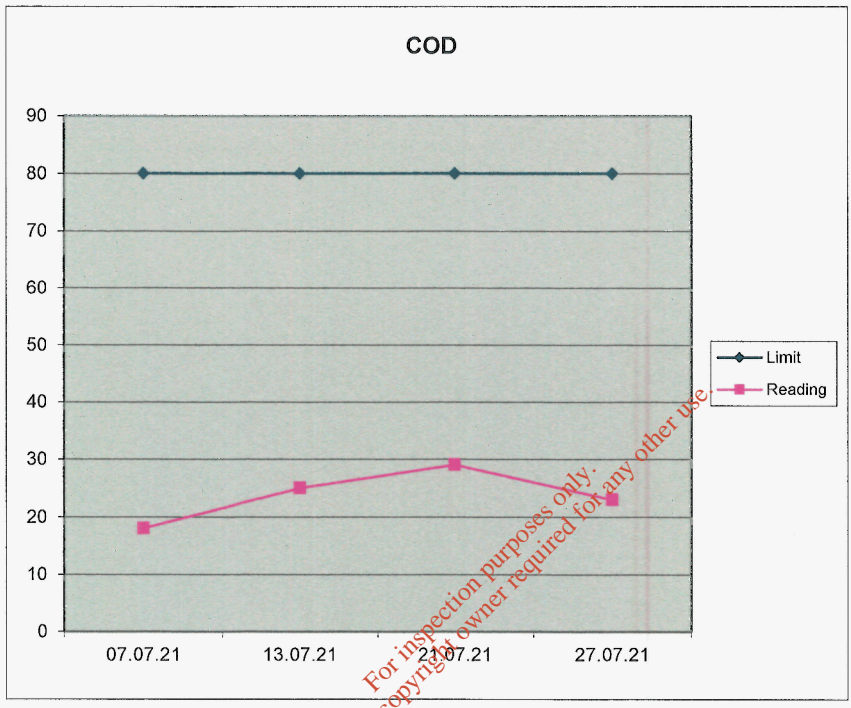

CELTIC WATERCARE



Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax 00 353 (0)21 4524717
E-mail info@celticwatercare.ie

Analysis Report


Charleville Foods
Ardnageehy
Charleville
Co Cork

Sample Type SW1

Final Discharge 07/07/2021

Test Parameter	Results Comp	Test Method
B.O.D	<2.0 mg/l	5 day Carbonaceous
C.O.D.	18.0 mg/ltr	Colourimetric
Suspended Solids	9.0 mg/ltr	Standard Method
pH	6.83	PH Meter
Orthophosphate (as P)	0.21 mg/ltr	Acid Digestion
Total Nitrogen (as N)	6.0 mg/ltr	Colourimetric
Ammonia (as N)	0.15 mg/ltr	Colourimetric
OFG	<5.0 mg/ltr	

Signed:



Date: 14/07/2021

For inspection purposes only.
Consent of copyright owner required for any other use.

CELTIC WATERCARE



Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax 00 353 (0)21 4524717
E-mail info@celticwatercare.ie

Analysis Report

Charleville Foods
Ardnageehy
Charleville
Co Cork

Sample Type SW1

Final Discharge 13/07/2021

Test Parameter	Results Comp	Test Method
B.O.D	<2.0 mg/l	5 day Carbonaceous
C.O.D.	25.0 mg/ltr	Colourimetric
Suspended Solids	10.0 mg/ltr	Standard Method
pH	6.78	PH Meter
Orthophosphate (as P)	0.24 mg/ltr	Acid Digestion
Total Nitrogen (as N)	6.6 mg/ltr	Colourimetric
Ammonia (as N)	0.20 mg/ltr	Colourimetric

Signed:



Date: 21/07/2021

For inspection purposes only.
Consent of copyright owner required for any other use.

CELTIC WATERCARE



Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax 00 353 (0)21 4524717
E-mail info@celticwatercare.ie

Analysis Report


Charleville Foods
Ardnageehy
Charleville
Co Cork

Sample Type SW1

Final Discharge 21/07/2021

Test Parameter	Results Comp	Test Method
B.O.D	< 2.0 mg/l	5 day Carbonaceous
C.O.D.	29.0 mg/ltr	Colourimetric
Suspended Solids	14.0 mg/ltr	Standard Method
pH	6.85	PH Meter
Orthophosphate (as P)	0.30 mg/ltr	Acid Digestion
Total Nitrogen (as N)	7.3 mg/ltr	Colourimetric
Ammonia (as N)	0.22 mg/ltr	Colourimetric

Signed:



Date: 28/07/2021

For inspection purposes only.
Consent of copyright owner required for any other use.

CELTIC WATERCARE



*Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax 00 353 (0)21 4524717
E-mail info@celticwatercare.ie*

Analysis Report


*Charleville Foods
Ardnageehy
Charleville
Co Cork*

Sample Type SW1

Final Discharge 27/07/2021

Test Parameter	Results Comp	Test Method
B.O.D	<2.0 mg/l	5 day Carbonaceous
C.O.D.	23.0 mg/ltr	Colourimetric
Suspended Solids	13.0 mg/ltr	Standard Method
pH	6.75	PH Meter
Orthophosphate (as P)	0.27 mg/ltr	Acid Digestion
Total Nitrogen (as N)	7.0 mg/ltr	Colourimetric
Ammonia (as N)	0.22 mg/ltr	Colourimetric

Signed:



Date: 04/08/2021

*For inspection purposes only.
Consent of copyright owner required for any other use.*

CELTIC WATERCARE



Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax: 00 353 (0)21 4524717
E-mail celticwatercareltd@eircom.net

Analysis Report
Surface water Analysis
07/07/2021

Charleville Foods
Ardnageehy
Charleville
Co Cork

Sample Type	SWD2	SWD3	METHOND
B.O.D	<2.00	NO FLOW	5 day Carbonaceous
Conductivity	750.0 uS/cm	NO FLOW	Conductivity Meter
PH	7.16	NO FLOW	PH Meter
Total Nitrogen (as N)	0.20 mg/l	NO FLOW	Colourmetric
Total Ammonia (as N)	0.13 mg/l	NO FLOW	Colourmetric

Signed:



Date: 14/07/2021

CELTIC WATERCARE



*Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax: 00 353 (0)21 4524717
E-mail celticwatercareltd@eircom.net*

Analysis Report
Surface water Analysis
13/07/2021

*Charleville Foods
Ardnageehy
Charleville
Co Cork*

Sample Type	SWD2	SWD3	METHOD
B.O.D	NO FLOW	NO FLOW	5 day Carbonaceous
Conductivity	NO FLOW	NO FLOW	Conductivity Meter
PH	NO FLOW	NO FLOW	PH Meter
Total Nitrogen (as N)	NO FLOW	NO FLOW	Colourmetric
Total Ammonia (as N)	NO FLOW	NO FLOW	Colourmetric

Signed:



Date: 21/07/2021

CELTIC WATERCARE




*Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax: 00 353 (0)21 4524717
E-mail celticwatercareltd@eircom.net*

Analysis Report
Surface water Analysis
21/07/2021

*Charleville Foods
Ardnageehy
Charleville
Co Cork*

Sample Type	SWD2	SWD3	METHOND
B.O.D	NO FLOW	NO FLOW	5 day Carbonaceous
Conductivity	NO FLOW	NO FLOW	Conductivity Meter
PH	NO FLOW	NO FLOW	PH Meter
Total Nitrogen (as N)	NO FLOW	NO FLOW	Colourmetric
Total Ammonia (as N)	NO FLOW	NO FLOW	Colourmetric

Signed:



Date: 28/07/2021

CELTIC WATERCARE



Unit 17 Little Island Business Park
Little Island Co Cork
Tel: 00 353 (0)21 4524716 Fax: 00 353 (0)21 4524717
E-mail celticwatercareltd@eircom.net

Analysis Report
Surface water Analysis
27/07/2021

Charleville Foods
Ardnageehy
Charleville
Co Cork

Sample Type	SWD2	SWD3	METHOD
B.O.D	-	NO FLOW	5 day Carbonaceous
Conductivity	490.0 uS/cm	NO FLOW	Conductivity Meter
PH	6.33	NO FLOW	PH Meter
Total Nitrogen (as N)	-	NO FLOW	Colourmetric
Total Ammonia (as N)	-	NO FLOW	Colourmetric

Signed:



Date: 03/08/2021

For inspection purposes only.
Consent of copyright owner required for any other use.